




Appendix A Tent Distance Visual Guide

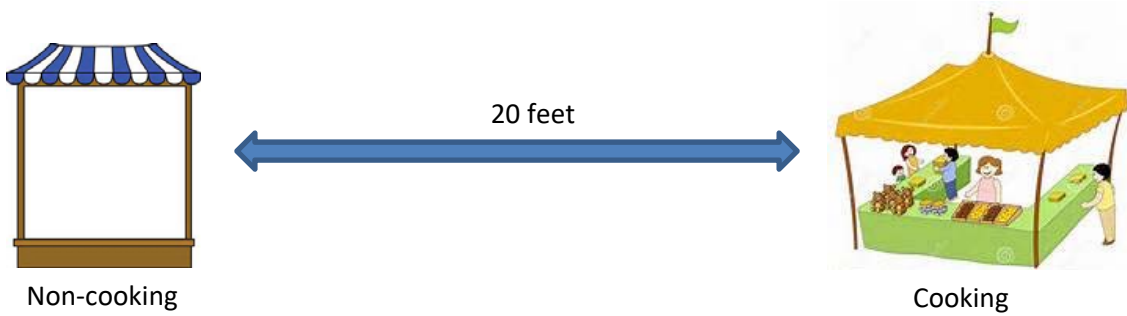

Cooking and non-cooking tents need to be separated by at least 20 feet

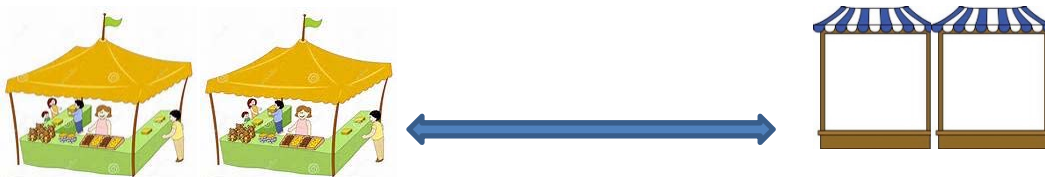

Multiple tents used for cooking do not need to be separated but must maintain a distance of 20' from non-cooking displays/tents.

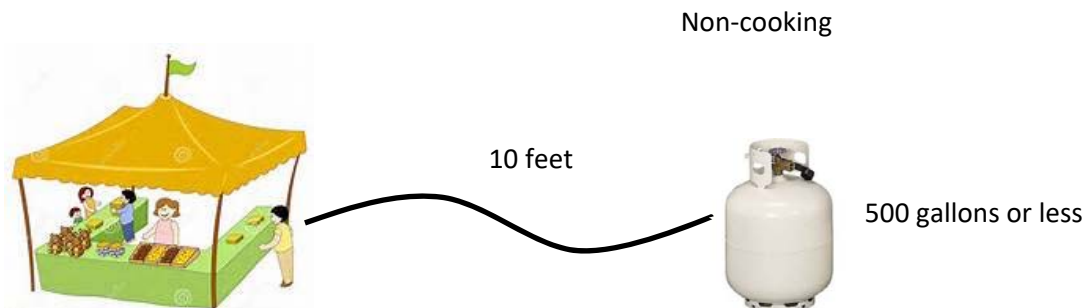

Propane cylinders 500 gallons or less must be at least 10 feet away from any tent



25 feet



greater than 500 gallons

Propane cylinders more than 500 gallons must be at least 25 feet away from any tent




Propane cylinders must have the regulator at the tank when vending at a tent



20 feet



Generators need to be at least 20 feet from any tent. Generators also need to be isolated from public contact.

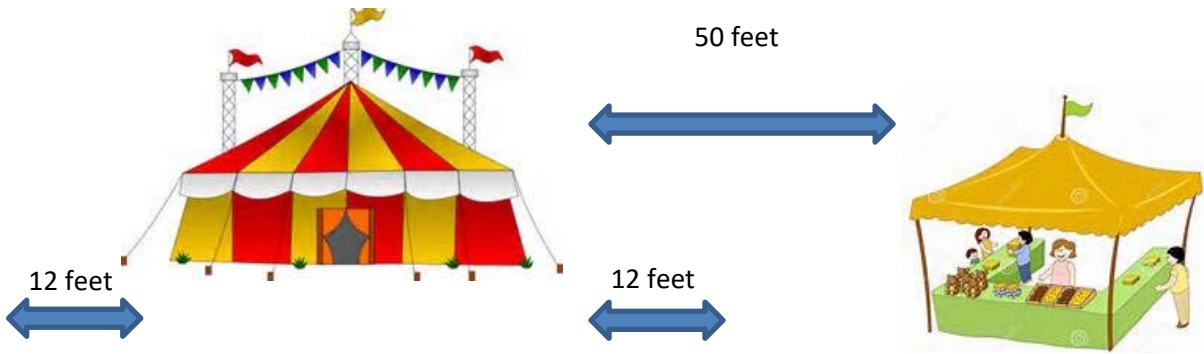

Tents greater than 15,000 square feet are required to be at least 50 feet from any tent or building. A 12 foot fire break must be maintained from any guy ropes or other obstructions on all sides of the tent.

Exception: A tent 15,000 square foot tent may be closer than 50 feet if it is adjoined to another tent by a corridor.